


F1: Supply and Communication Clearances at the

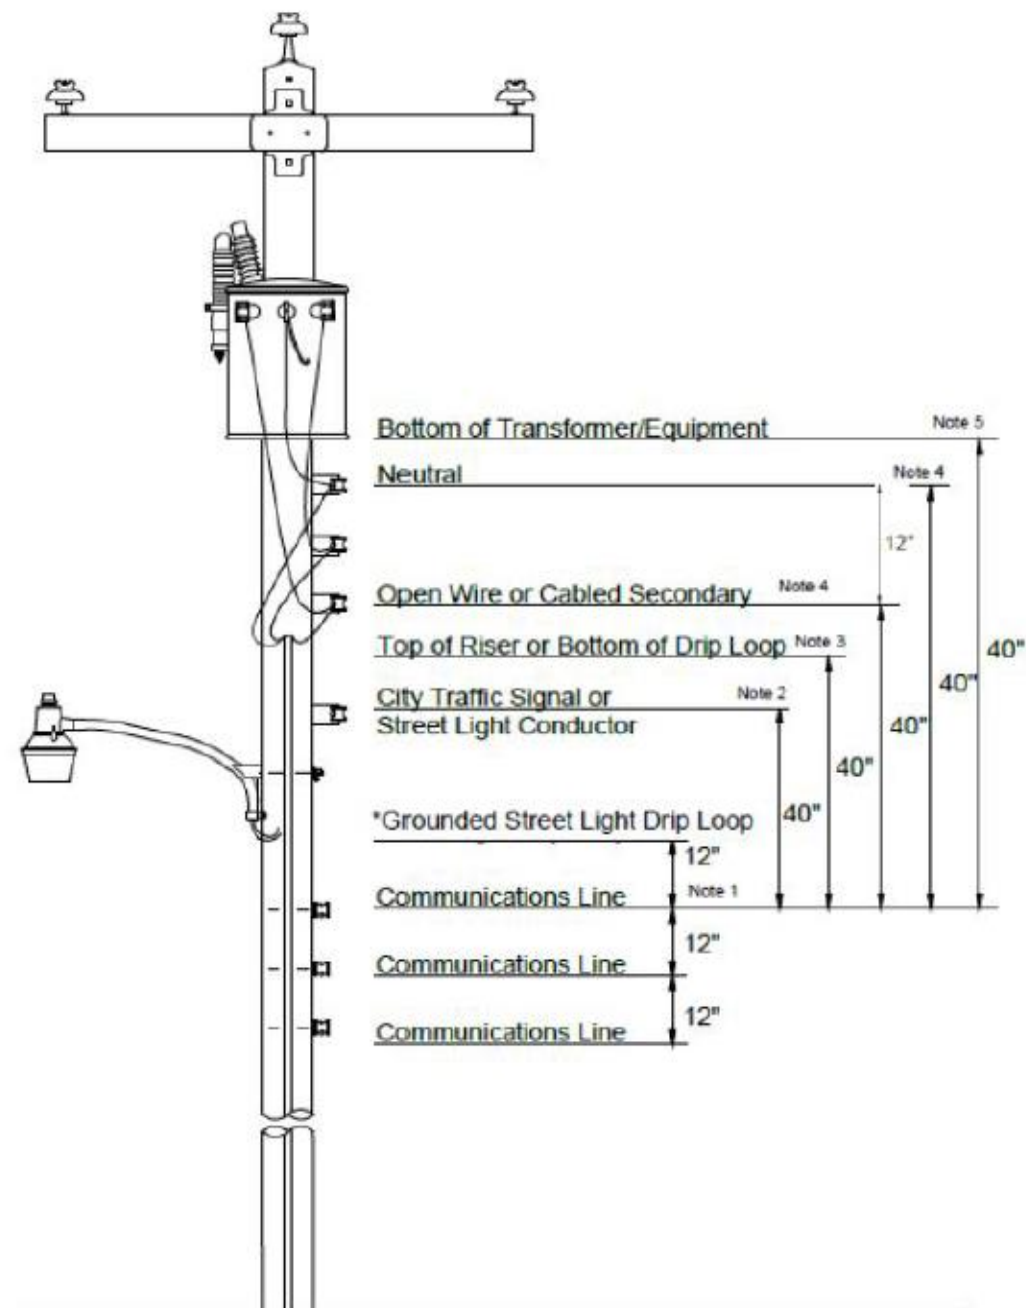

- Notes**
- 1 Communications line shall be a minimum of 12" below the Grounded Street Light
*Communications line shall be a minimum of 40" below a **non-grounded** Street Light
 - 2 Communications line shall be a minimum of 40" below the City Traffic Signal or Street Light Conductor
 - 3 Communications line shall be a minimum of 40" below the Top of Riser or Bottom of Drip Loop (whichever is lower)
 - 4 Communications line shall be a minimum of 40" below the Open Wire Secondary or Cabled Secondary
 - 5 Communications line shall be a minimum of 40" below the Bottom of Transformer