


## F6: Location of Vertical Runs

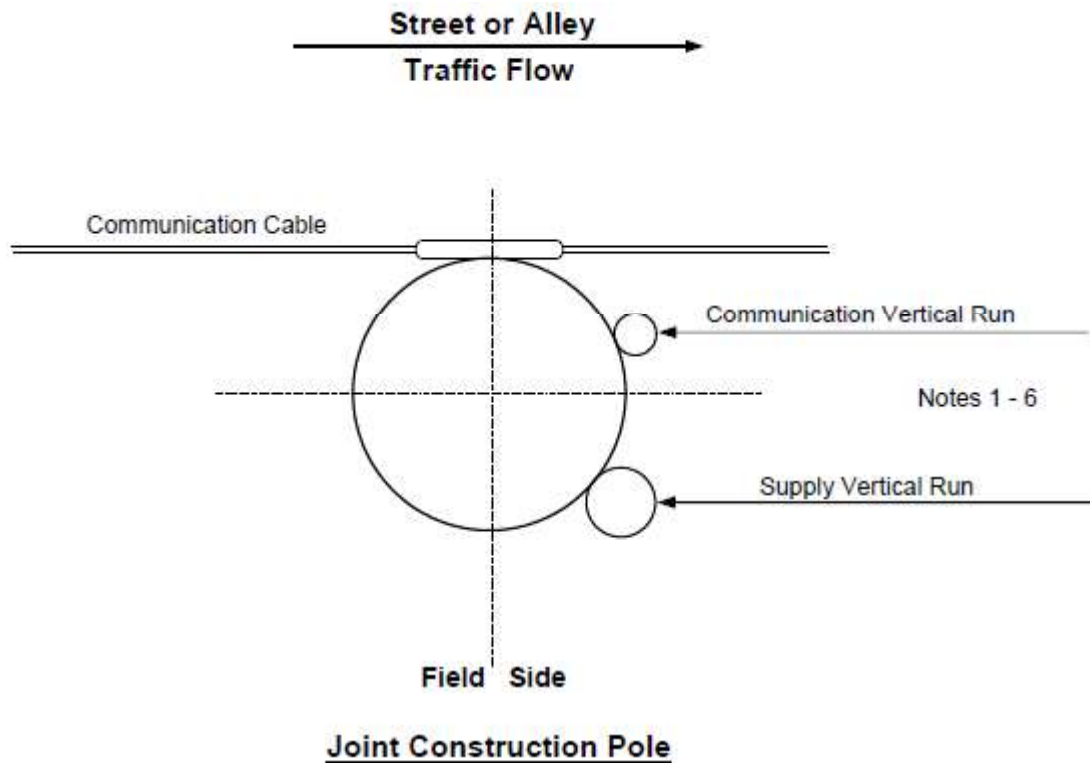

### Notes:

1. Supply and communication vertical runs shall not be made on the same pole where it is practicable to place them on separate poles.
2. Supply vertical runs shall be on quarter of pole opposite communication cable if existing, otherwise on field quarter of pole when along street or alley.
3. Locate supply vertical runs on side of pole away from the normal traffic flow where practicable.
4. Communication vertical runs shall be made on quarter of pole adjacent to communication cable and on side of pole away from the normal traffic flow where practicable.
5. All vertical runs shall be so arranged as not to interfere with climbing or working space. When the addition of a communication vertical run on pole with an existing supply vertical run obstructs more than 25% of the pole surface, the additional communication vertical run shall be mounted on standoff brackets a minimum of 4" and a maximum of 12" off the pole. Vertical runs facilitate climbing space as per the NESC. Vertical runs on standoff brackets should be in conduit as approved by the NESC.
6. Consult section 239 of the NESC for situations not covered by this standard.